

Hartmut Kiank, Wolfgang Fruth

Planning Guide for Power Distribution Plants

Design, Implementation and
Operation of Industrial Networks

SIEMENS

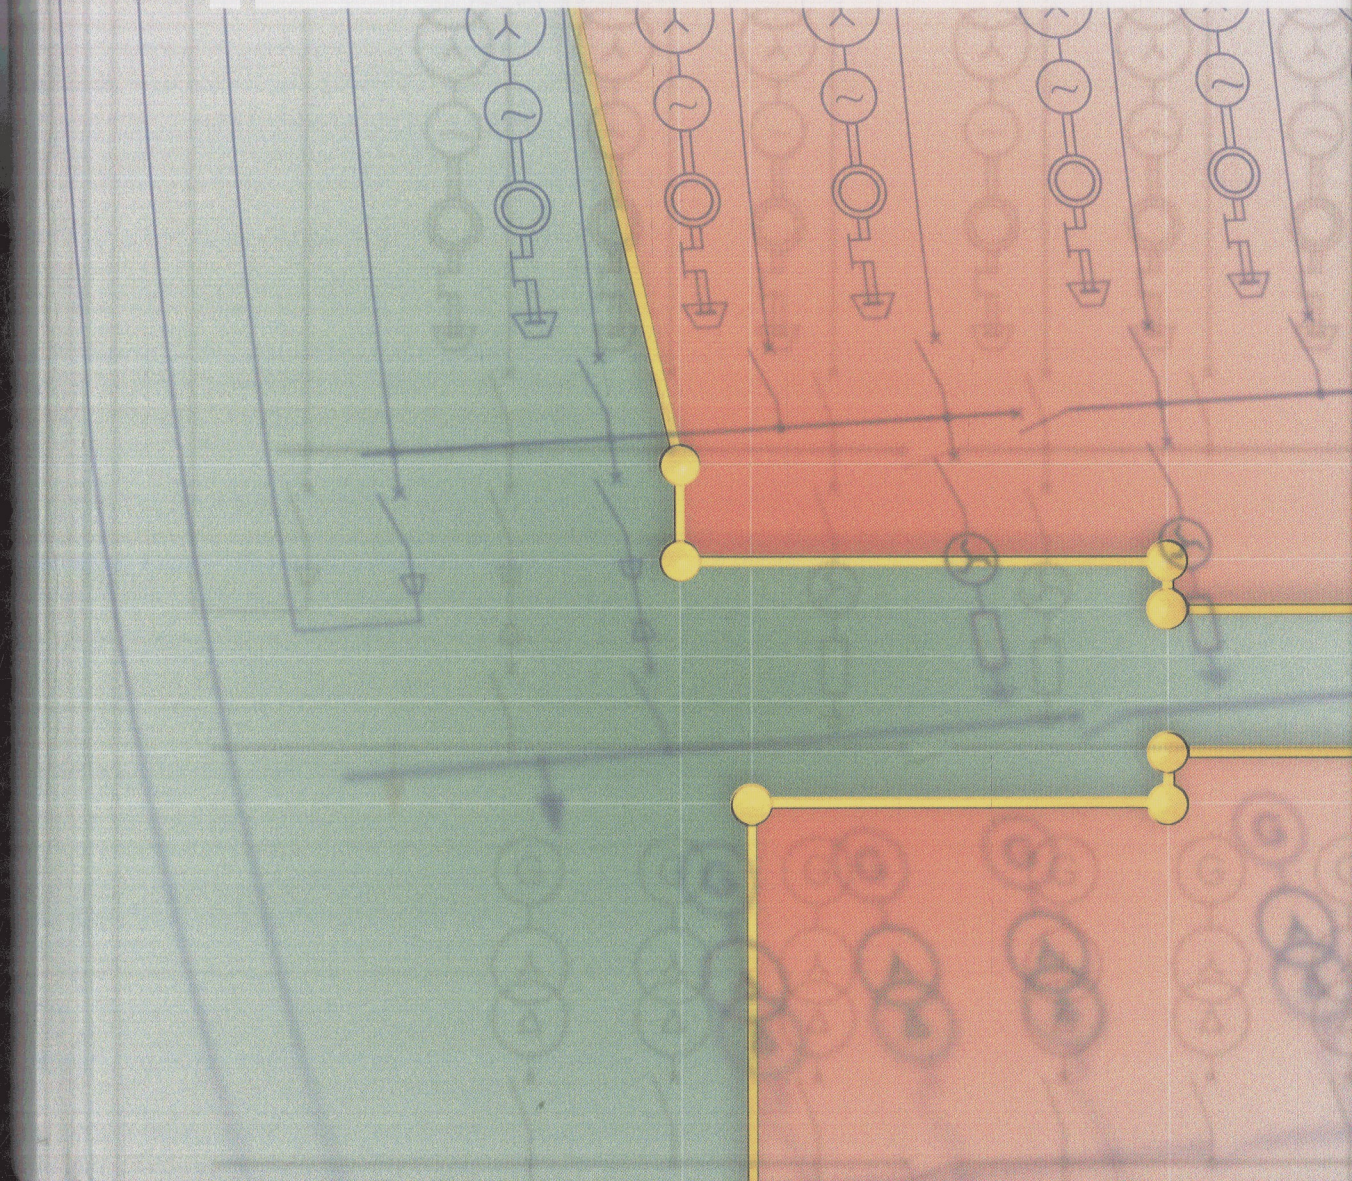


Table of contents

A Fundamentals

1 Introduction	13
1.1 Special aspects of industrial power systems	13
1.2 Need for complete power system and installation engineering solutions	15
1.3 Task of system planning	16
2 Basic workflow for planning	19
2.1 Top-down principle	19
2.2 Determining the state of the existing system	20
2.3 Determining the requirements	22
2.3.1 Power demand	22
2.3.2 Quality of supply	24
2.3.2.1 Supply reliability	24
2.3.2.2 Voltage quality	27
2.4 Determining of process-compliant power supply variants	34
2.5 Search for the optimum solution	42
2.5.1 Decision objectives	42
2.5.2 Decision-making method	43

B Planning recommendations for medium-voltage systems

3 Choosing the MV system voltage	47
3.1 Incoming supply level	47
3.2 Distribution level	48
4 Determining short-circuit stress and the necessary short-circuit withstand capability	51
4.1 Choosing the short-circuit power	51
4.2 Short-circuit withstand capability of the equipment	53
4.2.1 MV switchgear	53
4.2.2 MV cables	58
4.2.3 MV distribution transformers	60
5 Defining optimum system configurations for industrial power supplies	62
5.1 MV load structure in the metal-processing industry	62
5.2 Best MV/LV incoming supply variant in terms of power system engineering	62

5.3 Optimum system configuration for connecting transformer load-centre substations 63

5.4 System structures and concepts meeting the requirements for industrial plants 67

 5.4.1 Small industrial plants 67

 5.4.2 Medium-sized industrial plants 69

 5.4.3 Large industrial plants 71

 5.4.4 Production facilities of high-technology businesses 78

5.5 Switchgear classification for implementing the MV power system concepts 84

6 Choosing the neutral earthing 86

 6.1 Importance of neutral earthing 86

 6.2 Methods of neutral earthing 86

 6.3 Selection criterion and decision aid 107

 6.4 Selection recommendation for operation of MV cable networks in industry ... 109

 6.5 Neutral earthing on both sides of transfer transformers in operation of MV industrial power systems 110

7 Design of the MV power system protection 114

 7.1 Fundamentals of protection engineering and equipment 114

 7.2 Protection of supplying 110-kV/MV transformers 129

 7.3 Protection of MV distribution transformers 130

 7.3.1 Protection with a switch-fuse combination 132

 7.3.2 Protection with a circuit-breaker-relay combination 146

 7.4 Current-limiting short-circuit protection of motors and capacitors 150

 7.4.1 Fuse protection of HV motors 150

 7.4.2 Fuse protection of capacitors 154

 7.5 Protection of busbars 154

 7.6 Protection of lines 155

 7.6.1 Protection in the case of double-radial-line connection of system distribution substations 156

 7.6.2 Protection in the case of loop-in of system distribution substations 157

 7.7 Protection concept for a fictitious 20-kV industrial power system with low-impedance neutral earthing 159

C Planning recommendations for low-voltage systems

8 Choosing the LV system voltage 161

 8.1 Categorization of the LV level as the process and load level 161

 8.2 Voltages for the process and load level 161

9 Short-circuit power and currents in the low-voltage power system ... 166

 9.1 Types and currents of faults determining the dimensioning of the system and equipment 166

 9.2 Use of equipment reserves to handle short-circuit currents 170

10 Designing a low-voltage power system to meet requirements	173
10.1 Analysis of the load structure	173
10.1.1 Characteristic load groups in the metal-processing industry	173
10.1.1.1 Toolmaking and mechanical workshops	173
10.1.1.2 Punch and press shops	177
10.1.1.3 Welding shops	183
10.1.1.4 Painting and curing plants	195
10.1.1.5 Lighting systems	196
10.1.1.6 EDP and IT systems	199
10.2 Choosing the type of LV system earthing	202
10.2.1 System types possible according to the standards	202
10.2.1.1 IT system	208
10.2.1.2 TT system	212
10.2.1.3 TN system	217
10.2.2 EMC-compliant TN systems with multiple incoming supply	225
10.2.2.1 TN-EMC system with centralized multiple incoming supply	226
10.2.2.2 TN-EMC system with decentralized multiple incoming supply	228
10.3 Definition of the network configuration	230
10.3.1 Network configurations for power supply and distribution	230
10.3.1.1 Simple radial network	230
10.3.1.2 Radial network with switchover reserve capacity	231
10.3.1.3 Radial networks in an interconnected cable system	233
10.3.1.4 Multi-end-fed meshed network	234
10.3.1.5 Radial networks interconnected through busbar trunking systems	235
10.3.2 Selecting the economically and technically most favourable network configuration	236
11 Selecting and dimensioning the electrical equipment	238
11.1 Distribution transformers	238
11.2 Low-voltage switchboards and distribution board systems	244
11.2.1 SIVACON S8 switchboard	249
11.2.2 ALPHA 630 floor-mounted distribution board	255
11.2.3 ALPHA 8HP moulded-plastic distribution board	256
11.2.4 SIVACON 8PS busbar trunking system	257
11.2.5 Transformer load-centre substation with SIVACON S8/8PS	260
11.3 Cables	263
11.3.1 Permissible current-carrying capacity	263
11.3.2 Protection against overload	272
11.3.3 Protection against short circuit	275
11.3.4 Protection against electric shock	280
11.3.5 Permissible voltage drop	283
11.3.6 Dimensioning example	290
12 Reactive-power compensation	297
12.1 Technical and economic reasons for compensation	297
12.2 Compensation when supplying linear loads	297
12.2.1 Determining the necessary capacitive power	298
12.2.2 Types of reactive-power compensation	302

12.2.2.1 Individual compensation 302

12.2.2.2 Group compensation 303

12.2.2.3 Centralized compensation 303

12.2.2.4 Hybrid or mixed compensation 305

12.2.3 Choosing the most advantageous type of compensation 305

12.2.4 Reactive-power compensation of three-phase asynchronous motors
and distribution transformers 306

12.2.4.1 Three-phase asynchronous motors 306

12.2.4.2 Distribution transformers 309

12.2.5 Connecting and operating automatic compensation systems 312

12.2.5.1 Selecting a current transformer for the PF controller 313

12.2.5.2 Defining the number of steps and the step power 314

12.2.5.3 Setting the controller sensitivity (C/k response value) 315

12.2.5.4 Requirements, connection and fuse protection of the power capacitors 316

12.2.5.5 Reactions affecting audio-frequency ripple control systems 320

12.3 Compensation when supplying non-linear loads 323

12.3.1 Negative effects of harmonics on the power system 323

12.3.2 Measures to mitigate harmonics 328

12.3.2.1 Installation of capacitor units with reactors 328

12.3.2.2 Use of tuned filter circuits 332

12.3.2.3 Operation with active filters 335

12.4 Planning of compensation systems with products from Modl 336

12.5 Demonstration of the economic and technical benefit of reactive-power
compensation 339

13 Designing the LV power system protection 345

13.1 Fundamentals of protection engineering and equipment 345

13.1.1 Fuses 346

13.1.2 Circuit-breakers 347

13.1.3 Switchgear assemblies 351

13.1.4 Comparative evaluation of the characteristics of protective devices 354

13.2 Selectivity in LV networks 356

13.2.1 Radial networks 356

13.2.1.1 Selectivity between LV HRC fuses 357

13.2.1.2 Selectivity between circuit-breakers 358

13.2.1.3 Selectivity between a circuit-breaker and LV HRC fuse 362

13.2.1.4 Selectivity in case of incoming feeders connected in parallel 365

13.2.1.5 Selectivity and undervoltage protection 371

13.2.2 Meshed and closed ring-operated networks 372

13.2.2.1 Selectivity in meshed networks with node fuses 372

13.2.2.2 Selectivity in operation of radial networks in an interconnected
cable system 373

13.2.2.3 Selectivity in operation of radial networks interconnected through
busbar trunking systems 374

13.3 Example of selective protection coordination with SIMARIS® design 375

14 List of acronyms, abbreviations, symbols and subscripts used 382

14.1 Acronyms and abbreviations 382

14.2 Symbols 386

14.2.1	Currents	386
14.2.2	Voltages	386
14.2.3	Resistances	387
14.2.4	Powers and energy	387
14.2.5	Time/duration	388
14.2.6	Factors	388
14.2.7	Other quantities	389
14.3	Subscripts and superscripts	389
 References and further reading		391
Index		414